FIG.1

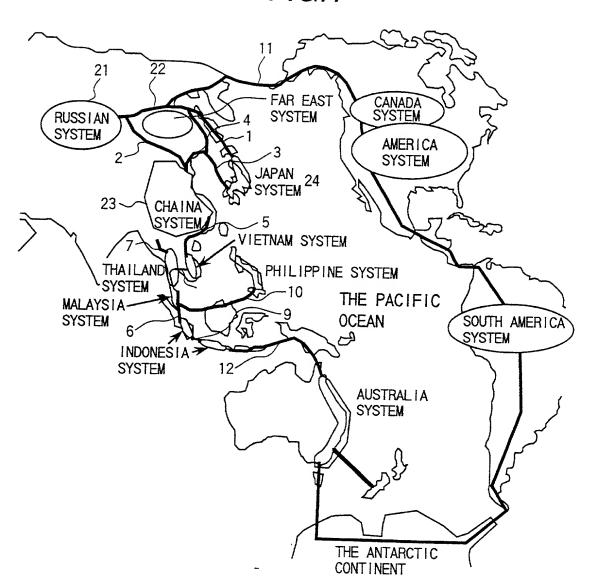


FIG.2

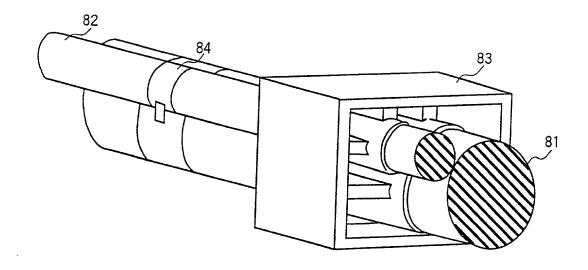


FIG.7

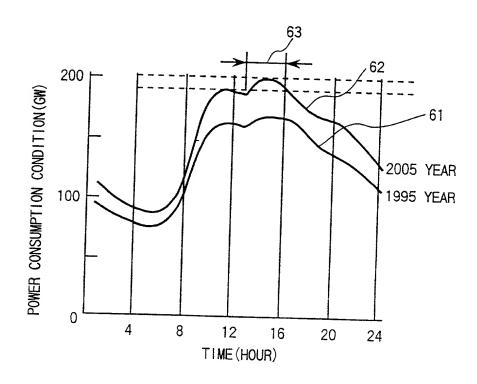
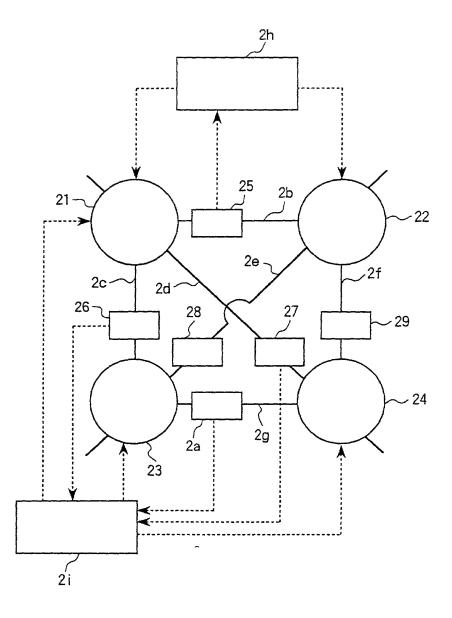
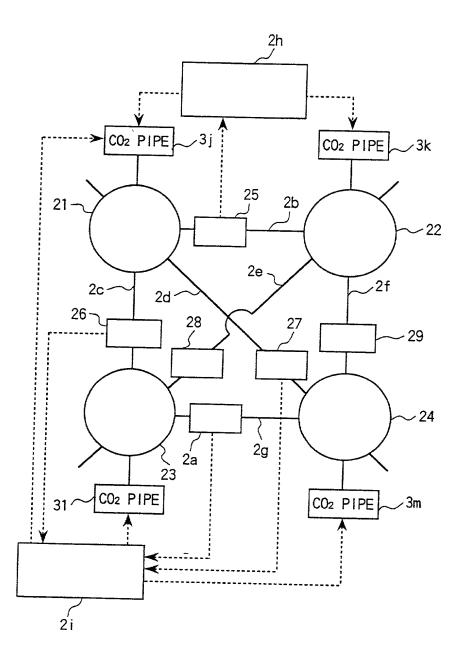


FIG.3





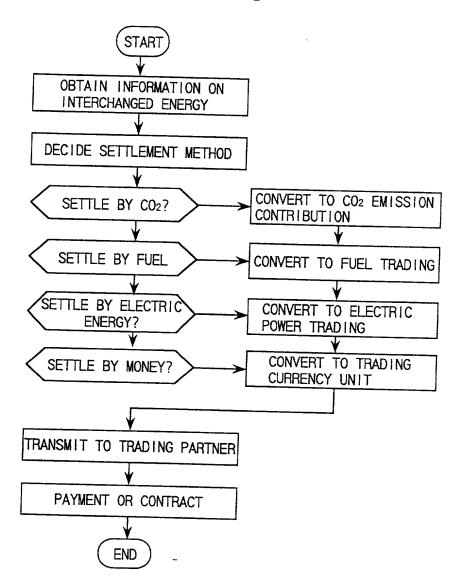
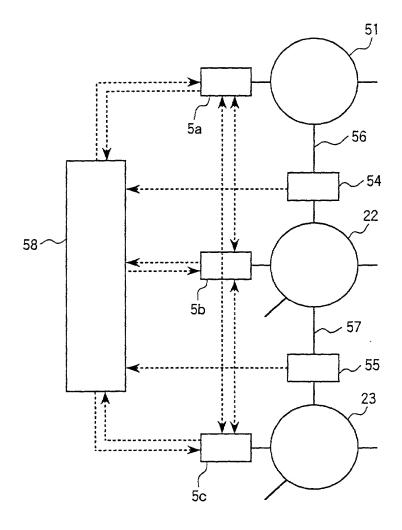
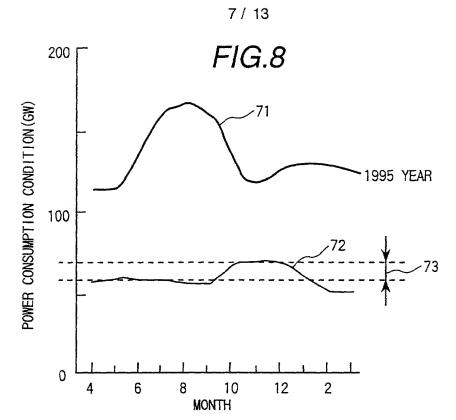


FIG.6





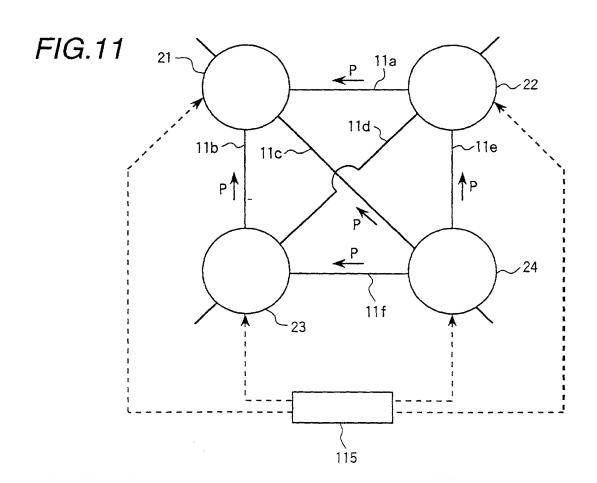
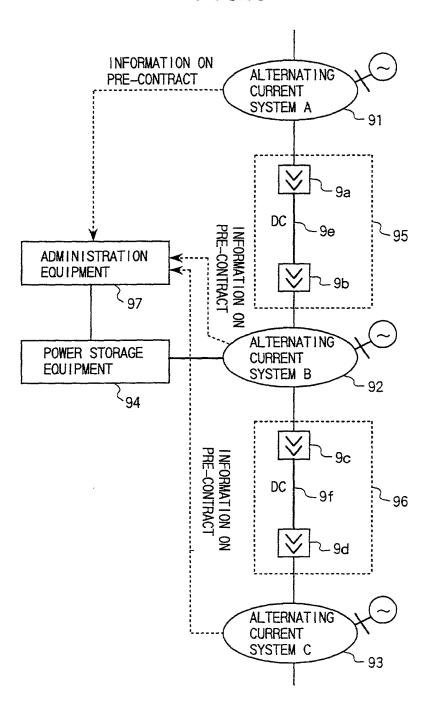
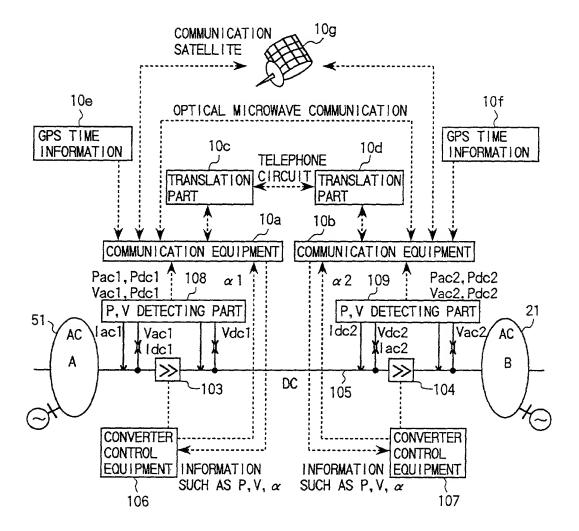
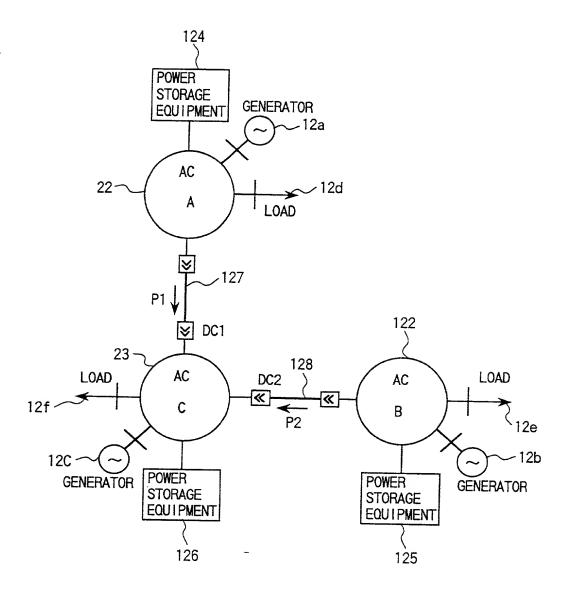


FIG.9







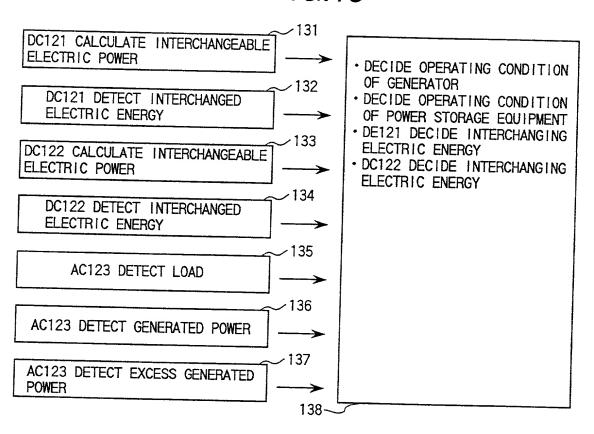


FIG.14 141 144 EXCAHNGE RATE INFORMATION 142 CHANGE DIRECT **POWER** CARRY OUT GENERATION COST MINIMIZATION CURRENT INFORMATION INTERCONNECTION CALCULATION OF POWER COMMAND POWER COST 143 VALUE POWER TRANSMISSION ROUTE INFORMATION 145

FIG.15

